



IECC 2021

nLight® Applications Guide





/ nLight Lighting Controls Platform

Not just smarter. Easier.

nLight is a digital lighting controls solution that offers wired and wireless lighting controls that easily connect luminaires, sensors, and other control devices to create a digital network. The nLight platform of products enables ease in specification, installation, and ownership, making it the go-to digital lighting controls platform for specifiers, contractors, and building owners.



/ TABLE OF CONTENTS

- 04 Code Requirements for Common Building Spaces
- 05 How to Use This Guide
- 06 Enclosed Office Solutions
- 08 Conference Room Solutions
- 10 Classroom Solutions
- 12 Gymnasium Solutions
- 13 Stairwell Solutions
- 14 Open Plan Office Solutions
- 16 Lobby Solutions
- 18 Corridor Solutions
- 20 Restroom Solutions
- 22 Warehouse Storage Solutions
- 23 Parking Garage Solutions
- 24 Site Lighting Solutions
- 25 Facade and Landscaping Solutions
- 26 nLight Hybrid Networked Lighting Control
- 27 Requirements Overview
- 28 Emergency Lighting
- 29 nLight Enabled Luminaires



/ ABOUT

About IECC 2021

The International Energy Conservation Code (IECC) 2021 is a residential and commercial building energy code. The IECC has been adopted by many states and municipalities. The intention of this code is to reduce energy consumption by outlining design and construction requirements which include specific constraints for lighting controls. The use of lighting controls to synchronize light levels with daylight, occupancy, and scheduled/manual inputs are required in order to be compliant.

About This Guide

Acuity Brands® offers the nLight® IECC Applications Guide as a reference of typical nLight layouts that help make code compliance quicker and easier. The Acuity Brands Design Services Team is also available to support engineers and contractors with detailed design, submittal, and installation. For additional information, please contact your Acuity Brands Sales Representative.

About nLight

nLight® is a sensor-based digital lighting controls solution that offers wired and wireless lighting controls that easily connect luminaires, sensors, and other control devices to create one digital lighting controls platform to aid in code compliance, reduce energy, and enable advanced networked capabilities. Ideal for practically any application, small to large, indoor to outdoor, nLight offers lighting controls that scale from one room to an entire floor, from one floor to an entire building, from one building to an entire campus.

The chart below is an overview of the Code Requirements for Common Building Spaces. Please use this information as a guide. For specific code requirements please refer to the IECC code.

	Control Requirement*	Code Provision	Code Summary*	Indoor Space Type										
				Enclosed Office, Copy / Print, Open Office <300ft	Conference, Meeting, Multipurpose Room	Classroom, Lecture Hall, Training Room	Gymnasium	Non-Exit Stairwell	Open Plan Office	Lobby	Corridor	Restroom	Warehouse	
On-Off Control	Manual-On or AutoOn ≤ 50%	C405.2.1.1.2	Automatically controlled spaces must be controlled to automatically turn the lighting on to not more than 50% power.	✓	✓	✓	✓							
	Full Automatic-On	C405.2.1.1, exception	Automatically controlled spaces are allowed to turn on to full.					✓	✓	✓		✓	✓	
	Manual Control (Local Switch)	C405.2.1.1.3	Areas with occupant sensors shall incorporate a manual control to allow occupants to turn fixtures off.	✓	✓	✓	✓						✓	
	Auto Reduce Light Level via Occupancy	C405.2.1.2.2 C405.2.1.3.4 C405.2.1.4 C405.2.7.3.2 C405.2.8.1	Occupancy sensors shall automatically reduce lighting.						✓			✓	✓	
	Time-Switch Controls (via System Controller)	C405.2.2.1 C405.2.7.2 C405.2.7.3.1.1 C405.2.7.3.1.2	Each area not provided with occupant sensor controls shall be provided with time switch controls.					✓	✓	✓	✓	(and)	✓	
	Full Auto-Off via Occupancy Sensor	C405.2.1.1.1 C405.2.7.3.1.3	Fixtures must automatically turn off within 20 minutes of all occupants leaving the space.	✓	✓	✓	✓	(or)	(or)	(or)	(or)		(or)	
	Light Reduction Controls	C405.2.3.1	Spaces shall have a manual control that allows the occupant to reduce the connected lighting load uniformly by not less than 50%.					✓**			✓**			
	Automatic Receptacle Control	C405.11.1	50% of all receptacles, and 25% of branch circuit feeders installed for modular furniture, shall be automatically turned off by an occupant sensor within 20 minutes of all occupants leaving the space.	✓	✓	✓				✓				
Daylight Control	Daylight-Responsive Controls	C405.2.4.1 C405.2.4.2 C405.2.7.1 C405.2.8.2 C405.2.8.3	Daylight-responsive controls shall be provided.	✓	✓	✓	✓		✓	✓		✓		

Notes:
 *This summary is for general information purposes only and is provided without any warranty as to accuracy, completeness, or otherwise. The user should read the applicable code sections for more complete and detailed descriptions of code requirements and exceptions and should consult with a professional engineer or other competent advisor before making any decision or taking any action based on this summary.
 **Light-reduction control required in conjunction with time-switch control where occupancy sensors are not provided.

Outdoor Space Type		
Parking Garage	Site, Parking Area	Facade and Landscape
✓	✓	
	(or)	
✓	✓	✓
(or)		
✓		✓
✓	✓	✓

For each space type there will be a wired solution on the left and wireless solution on the right.

Room description: ENCLOSED OFFICE: < 250 sq. ft., Windows, nLight Enabled Fixtures

Room layout diagram with controls, fixtures, and wiring

Wire type legend

Required list of devices in order to implement room layout design above

Operational details describe the functionality provided by the equipment specified in the solution

Additional options that add control capacity beyond code requirements

Wired

Wireless

Legend:
 - Blue line: CAT-5e Cable
 - Red line: Line Voltage Wires
 - Red arrow: Line Power Feed

Bill of Materials				Bill of Materials			
Symbol	Qty	Product #	Description	Symbol	Qty	Product #	Description
[Icon]	2	See Note	nLight Wired Enabled Troffer with Sensor Option	[Icon]	2	See Note	nLight AIR Enabled Troffer with Sensor Option
[Icon]	1	nWSXA PDT LV DX	Wall Switch Occupancy Sensor with On/Off, Raise/Lower	[Icon]	1	rPODBA DX G2	Battery Powered, On/Off, Raise/Lower WallPod
[Icon]	1	nPP20 PL	Plug Load Relay Pack	[Icon]	1	rPP20 24V EFP G2	Plug Load Relay Pack

OPERATIONAL DETAILS:

- Light Fixtures:**
 - All fixtures are dimmable
 - All fixtures can be controlled together or independently
 - Maximum level can be task tuned to any percentage via programming
- Occupancy Control:**
 - Fixtures must be turned on manually (or optionally can be configured to come on automatically to 50%)
 - Fixtures and plug load automatically turn off when room becomes vacant
 - Plug load turns on automatically
- Daylight Control:**
 - Not required for offices without windows or that have loads <150W in sidelit zones
- Manual Control:**
 - On/off & raise/lower control of fixtures
 - Raise/lower control is not required for spaces with occupancy sensors but is recommended


ADDITIONAL OPTIONS:

- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Control), and also qualify for Enhanced Digital Lighting Controls (C405.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE® controller
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLLC) (C405.2.2)
- For emergency lighting control use a power pack with ERIEM option or nLight Enabled Fixture with emergency option


Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLLC), as specified in the IECC 2021 CODE.

www.nlightcontrols.com • 800-535-2465

Wired

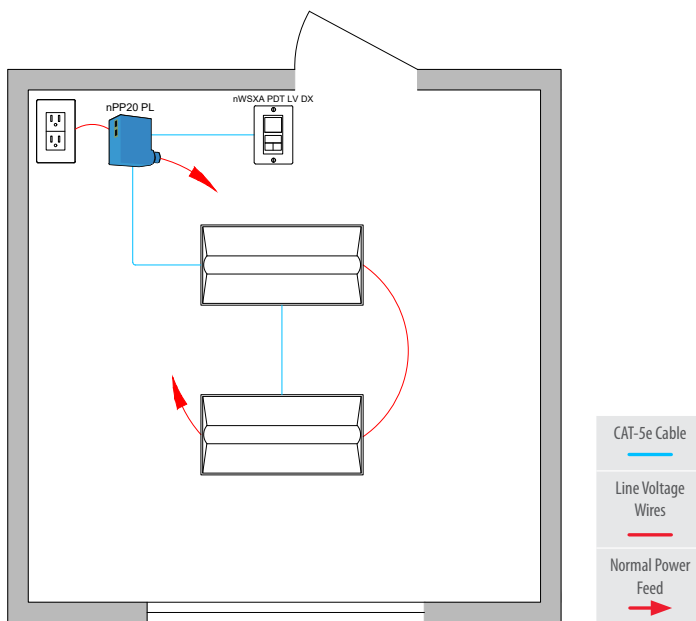

Wireless

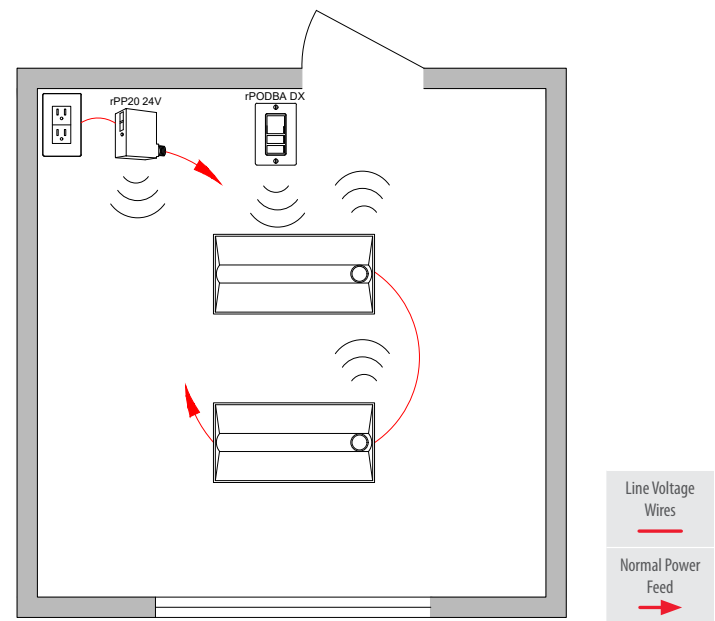

Bill of Materials

Symbol	Qty	Product #	Description
	2	See Note	nLight Wired Enabled Troffer with Sensor Option
	1	nWSXA PDT LV DX	Wall Switch Occupancy Sensor with On/Off, Raise/Lower
	1	nPP20 PL	Plug Load Relay Pack

Bill of Materials

Symbol	Qty	Product #	Description
	2	See Note	nLight AIR Enabled Troffer with Sensor Option
	1	rPODBA DX G2	Battery Powered, On/Off, Raise/Lower WallPod
	1	rPP20 24V EFP G2	Plug Load Relay Pack

/ OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- All fixtures can be controlled together or independently
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:

- Fixtures must be turned on manually (or optionally can be configured to come on automatically to 50%)
- Fixtures and plug load automatically turn off when room becomes vacant
- Plug load turns on automatically

Daylight Control:

- Not required for offices without windows or that have loads <150W in sidelit zones

Manual Control:


- On/off & raise/lower control of fixtures
- Raise/lower control is not required for spaces with occupancy sensors but is recommended

/ ADDITIONAL OPTIONS:


- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE® controller
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLLC) (C405.2.5)
- For emergency lighting control use a power pack with ER/EM option or nLight Enabled Fixture with emergency option

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLLC), as specified in the IECC 2021 CODE.

Wired

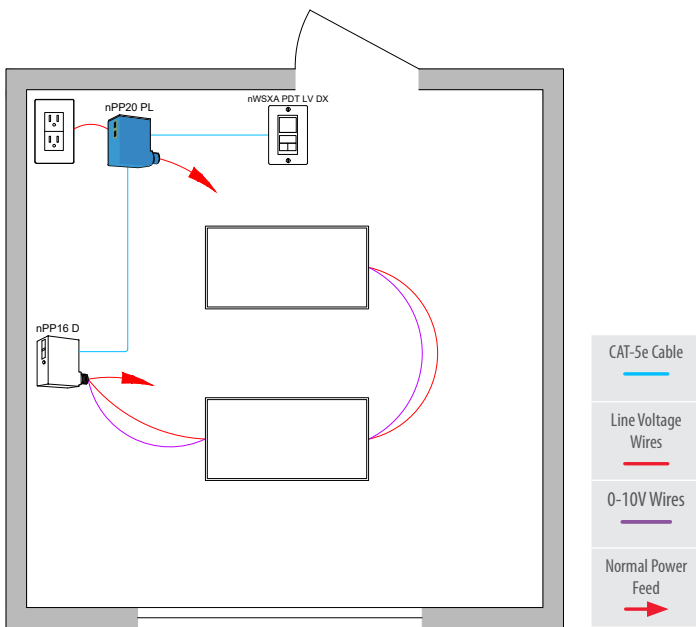

Wireless

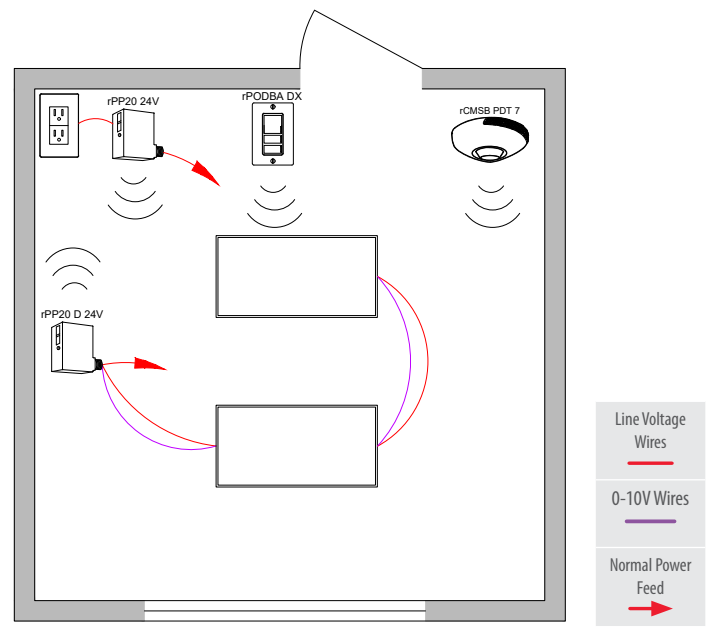

Bill of Materials

Symbol	Qty	Product #	Description
	1	nPP16 D EFP	Relay Pack with 0-10V Dimming Output
	1	nWSXA PDT LV DX	Wall Switch Occupancy Sensor with On/Off, Raise/Lower
	1	nPP20 PL	Plug Load Relay Pack

Bill of Materials

Symbol	Qty	Product #	Description
	1	rPP20 D 24V EFP G2	Relay Pack with 0-10V Dimming Output
	1	rPP20 24V EFP G2	Plug Load Relay Pack
	1	rPODBA DX G2	Battery Powered, On/Off, Raise/Lower WallPod
	1	rCMSB PDT 7 G2	Battery Powered Occupancy and Daylight Sensor

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- All fixtures are controlled together
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:

- Fixtures must be turned on manually (or optionally can be configured to come on automatically to 50%)
- Fixtures and plug load automatically turn off when room becomes vacant
- Plug load turns on automatically

Daylight Control:

- Not required for offices without windows or that have loads <150W in sidelit zone

Manual Control:



- On/off & raise/lower control of fixtures
- Raise/lower control is not required for spaces with occupancy sensors but is recommended

ADDITIONAL OPTIONS:

- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE® controller
- For emergency lighting control use a power pack with ER/EM option or nLight Enabled Fixture with emergency option

Wired

Wireless

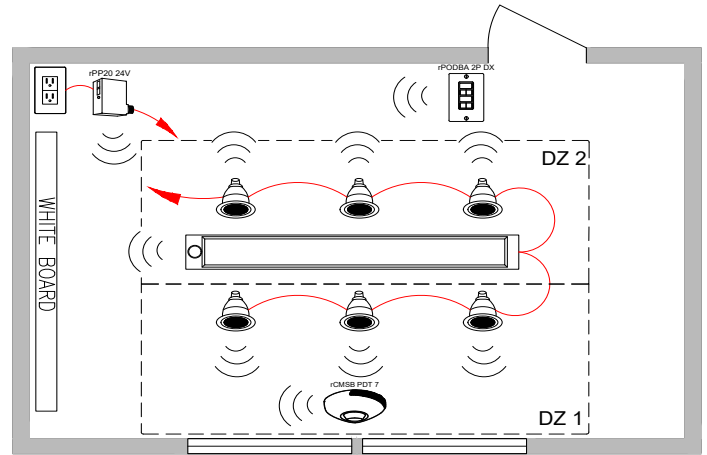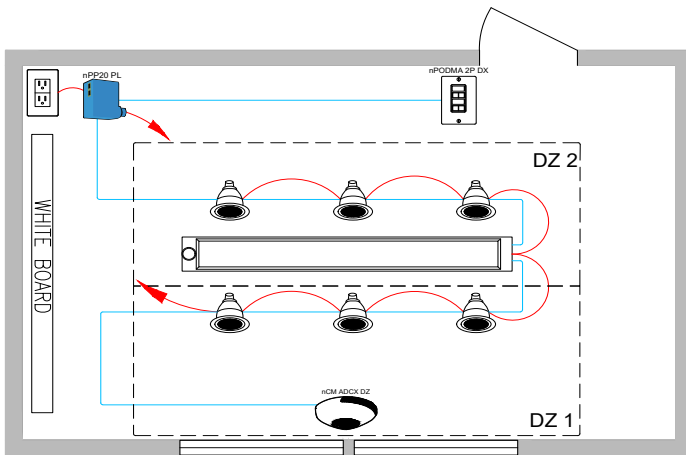

Bill of Materials

Symbol	Qty	Product #	Description
	1	See Note	nLight Wired Enabled Linear Fixture with Sensor Option
	6	See Note	nLight Wired Enabled Downlight Fixture
	1	nPODMA 2P DX	2-Pole, On/Off, Raise/Lower WallPod
	1	nPP20 PL	Plug Load Relay Pack
	1	nCM ADCX DZ RJB	Dual Zone Daylight Sensor

Bill of Materials

Symbol	Qty	Product #	Description
	1	See Note	nLight AIR Enabled Linear Fixture with Sensor Option
	6	See Note	nLight AIR Enabled Downlight Fixture
	1	rPODBA 2P DX G2	Battery Powered, 2-Pole, On/Off, Raise/Lower WallPod
	1	rPP20 24V EFP G2	Plug Load Relay Pack
	1	rCMSB PDT 7 G2	Battery Powered Occupancy and Daylight Sensor

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- Maximum level can be task tuned to any percentage via programming
- A/V zone can be programmed to control two fixtures in front of the whiteboard

Occupancy Control:

- Fixtures must be turned on manually (or optionally can be configured to come on automatically to 50%)
- Fixtures and plug load automatically turn off when room becomes vacant
- Plug load turns on automatically

Daylight Control:

- Smooth continuous dimming
- Daylight zones sizes defined by window size or skylight placement (not shown)
- Not required for areas without windows or that have loads <150w in sidelit zones

Manual Control:


- On/off & raise lower control of two zones of fixtures
- Raise/lower control is not required for spaces with occupancy sensors but is recommended

ADDITIONAL OPTIONS:


- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLLC) (C405.2.5)
- For emergency lighting control use a power pack with ER/EM option or nLight Enabled Fixture with emergency option

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLLC), as specified in the IECC 2021 CODE.

Wired

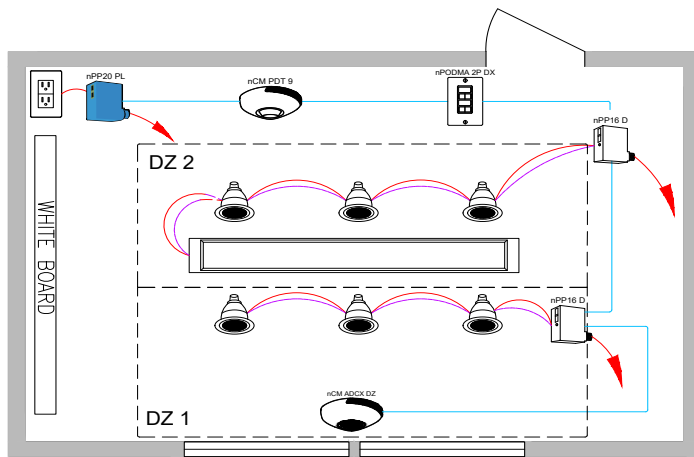

Wireless

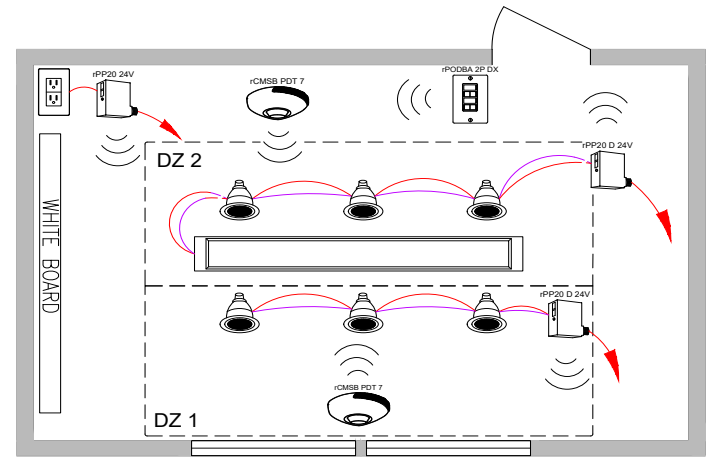

Bill of Materials

Symbol	Qty	Product #	Description
	2	nPP16 D EFP	Relay Pack with 0-10V Dimming Output
	1	nPODMA 2P DX	2-Pole, On/Off, Raise/Lower WallPod
	1	nCM PDT 9 RJB	Occupancy Sensor
	1	nCM ADCX DZ RJB	Dual Zone Daylight Sensor
	1	nPP20 PL	Plug Load Relay Pack

Bill of Materials

Symbol	Qty	Product #	Description
	2	rPP20 D 24V EFP G2	Relay Pack with 0-10V Dimming Output
	1	rPODBA 2P DX G2	Battery Powered, 2-Pole, On/Off, Raise/Lower WallPod
	2	rCMSB PDT 7 G2	Battery Powered Occupancy and Daylight Sensor
	1	rPP20 24V EFP G2	Plug Load Relay Pack

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:

- Fixtures must be turned on manually (or optionally can be configured to come on automatically to 50%)
- Fixtures and plug load automatically turn off when room becomes vacant
- Plug load turns on automatically

Daylight Control:

- Smooth continuous dimming
- Daylight zones sizes defined by window size or skylight placement (not shown)
- Not required for areas without windows or that have loads <150W in sidelit zones


Manual Control:

- On/off & raise lower control of two zones of fixtures
- Raise/lower control is not required for spaces with occupancy sensors but is recommended


ADDITIONAL OPTIONS:

- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- For emergency lighting control use a power pack with ER/EM option or nLight Enabled Fixture with emergency option

Wired

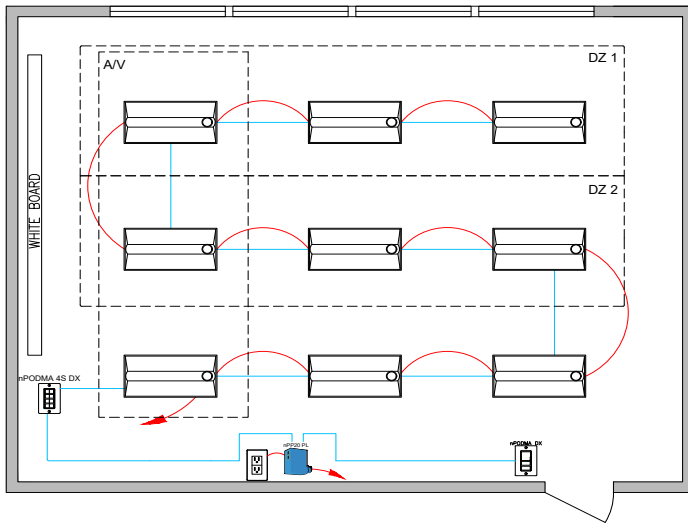

Wireless

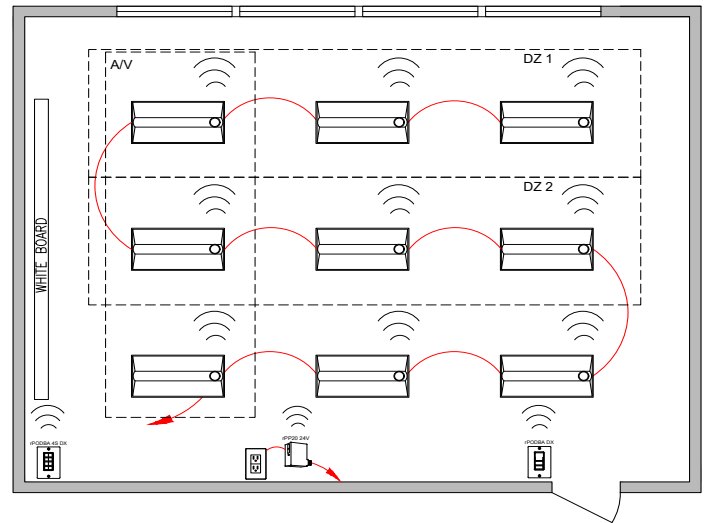

Bill of Materials

Symbol	Qty	Product #	Description
	9	See Note	nLight Wired Enabled Troffer with Sensor Option
	1	nPODMA DX	On/Off, Raise/Lower WallPod
	1	nPP20 PL	Plug Load Relay Pack
	1	nPODMA 4S DX	Teacher Station — 4 Scene Control with Master On/Off & Raise/Lower

Bill of Materials

Symbol	Qty	Product #	Description
	9	See Note	nLight AIR Enabled Troffer with Sensor Option
	1	rPODBA DX G2	Battery Powered, On/Off, Raise/Lower WallPod
	1	rPODBA 4S DX G2	Teacher Station — Battery Powered 4 Scene Control with Master On/Off & Raise/Lower
	1	rPP20 24V EFP G2	Plug Load Relay Pack

/ OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- All fixtures are controlled together or independently
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:

- Fixtures must be turned on manually (or optionally can be configured to some on automatically to 50%)
- Fixtures and plug load automatically turn off when room becomes vacant
- Plug load turns on automatically

Daylight Control:

- Smooth continuous dimming
- Daylight zones sizes defined by window size or skylight placement (not shown)
- Not required for areas without windows or that have loads <150W in sidelit zones

Manual Control:


- On/off & raise/lower control of entire room
- Teacher station with 4 preset scenes
- Raise/lower control is not required for spaces with occupancy sensors but is recommended

/ ADDITIONAL OPTIONS:


- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLC) (C405.2.5)
- For emergency lighting control use a power pack with ER/EM option or nLight Enabled Fixture with emergency option

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLC), as specified in the IECC 2021 CODE.

Wired

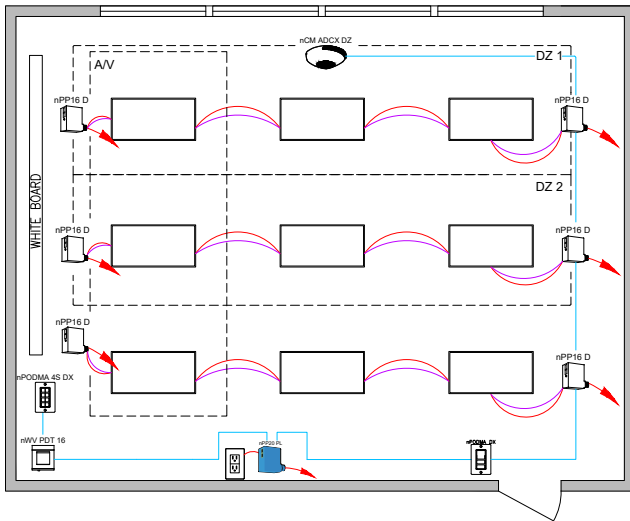

Wireless

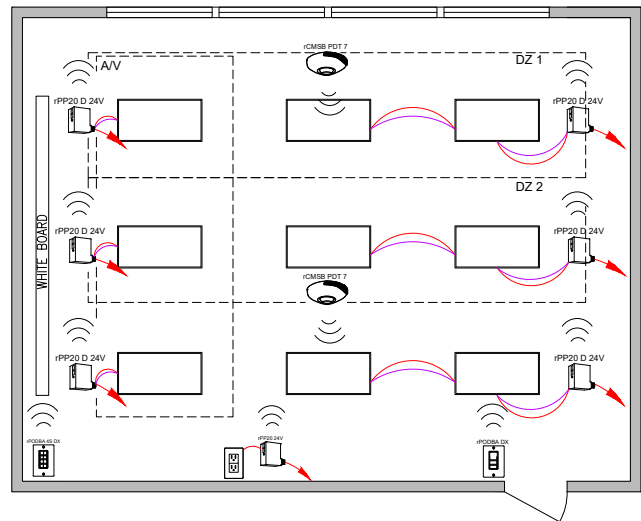

Bill of Materials

Symbol	Qty	Product #	Description
	6	nPP16 D EFP	Relay Module with 0-10V Dimming Output
	1	nPODMA DX	On/Off, Raise/Lower WallPod
	1	nWV PDT 16	Dual Technology Wide View Occupancy Sensor
	1	nPODMA 4S DX	Teacher Station — 4 Scene Control with Master On/Off & Raise/Lower
	1	nCM ADCX DZ RJB	Dual Zone Daylight Sensor
	1	nPP20 PL	Plug Load Relay Pack

Bill of Materials

Symbol	Qty	Product #	Description
	6	rPP20 D 24V EFP G2	Relay Pack with 0-10V Dimming Output
	1	rPODBA DX G2	Battery Powered, On/Off, Raise/Lower WallPod
	2	rCMSB PDT 7 G2	Battery Powered Occupancy and Daylight Sensor
	1	rPODBA 4S DX G2	Teacher Station — Battery Powered 4 Scene Control with Master On/Off & Raise/Lower
	1	rPP20 24V EFP G2	Plug Load Relay Pack

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- Each row can be controlled independently
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:

- Fixtures must be turned on manually (or optionally can be configured to come on automatically to 50%)
- Fixtures and plug load automatically turn off when room becomes vacant
- Plug load turns on automatically

Daylight Control:

- Smooth continuous dimming
- Daylight zones sizes defined by window size or skylight placement (not shown)
- Not required for areas without windows or that have loads <150W in sidelit zones


Manual Control:

- Master on/off & raise/lower control of entire room
- Teacher station with 4 preset scenes
- Raise/lower control is not required for spaces with occupancy sensors but is recommended

ADDITIONAL OPTIONS:

- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- For emergency lighting control use a power pack with ER/EM option or nLight Enabled Fixture with emergency option

Wireless with nLight Enabled Fixtures

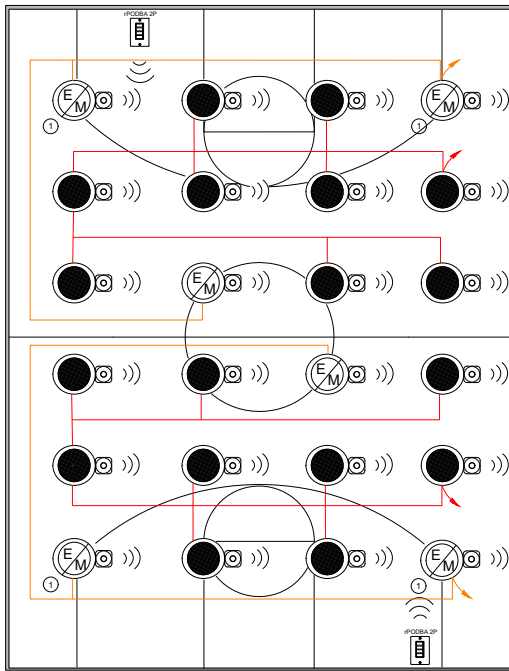

1 Fixture(s) assumed to include nLight AIR EM emergency options. For battery backup option, no dedicated emergency circuit necessary. nLight AIR devices with an EM option must be grouped with a normal power sensing device to exit emergency operation. See control device spec sheet for details.



Bill of Materials

Symbol	Qty	Product #	Description
	18	See Notes	nLight AIR Enabled Fixture with Sensor Option
	6	See Notes	nLight AIR Enabled Fixture with Sensor and EM Option
	2	rPODBA 2P G2	Battery Powered, 2-Pole, On/Off WallPod

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:

- Fixtures automatically go to full bright when occupied
- Fixtures automatically turn off or optionally can be configured to drop to low dim setting when space becomes vacant

Daylight Control:


- Daylight responsive controls lights to full off when adequate daylight present
- Not required for spaces without skylights or that have loads <150W in toplit zones

Manual Control:

- On/off & raise/lower control of fixtures
- Raise/lower control is not required for spaces with occupancy sensors but is recommended

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLLC), as specified in the IECC 2021 CODE.

Wireless with 0-10V Dimming Fixtures

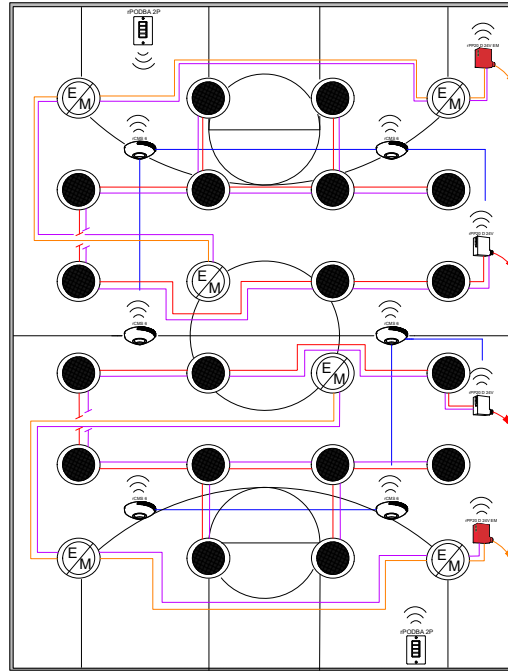

1 nLight AIR devices with an EM option must be grouped with a normal power sensing device to exit emergency operation. See control device spec sheet for details.




Bill of Materials

Symbol	Qty	Product #	Description
	2	rPP20 D 24V EFP G2	Relay Pack with 0-10V Dimming Output
	2	rPP20 D 24V EM EFP G2	Emergency Relay Pack with 0-10V Dimming Output
	2	rPODBA 2P G2	Battery Powered, 2-Pole, On/Off WallPod
	6	rCMS 6 G2	High Bay Occupancy Sensor

ADDITIONAL OPTIONS:


- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLLC) (C405.2.5)

Wireless with nLight Enabled Fixtures

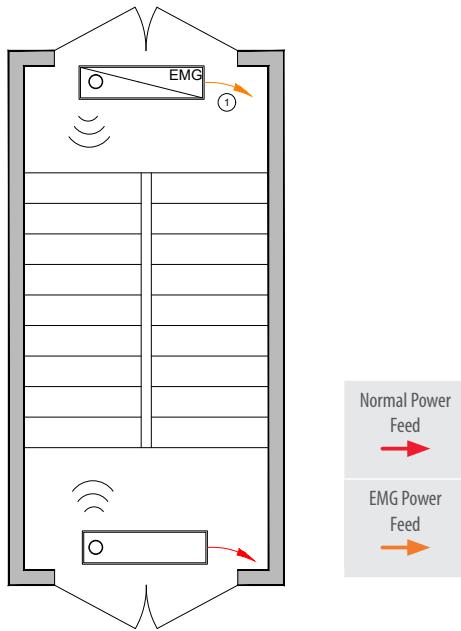

① Fixture(s) assumed to include nLight AIR EM emergency options. For battery backup option, no dedicated emergency circuit necessary. nLight AIR devices with an EM option must be grouped with a normal power sensing device to exit emergency operation. See control device spec sheet for details.

Wireless with 0-10V Dimming Fixtures

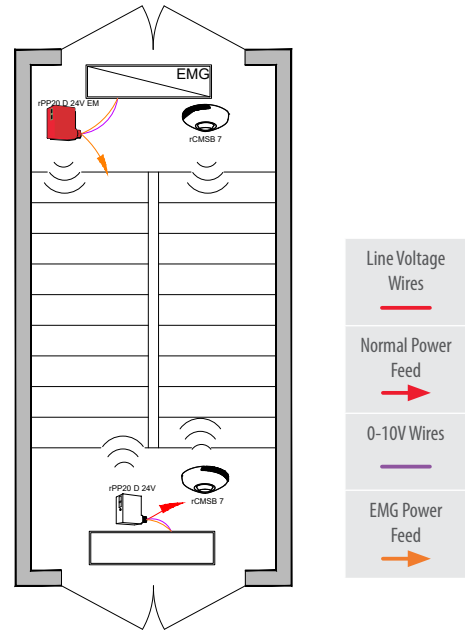

① nLight AIR devices with an EM option must be grouped with a normal power sensing device to exit emergency operation. See control device spec sheet for details.

Bill of Materials

Symbol	Qty	Product #	Description
	1	See Note	nLight AIR Enabled Fixture with Sensor Option
	1	See Note	nLight AIR Enabled Fixture with Sensor and EM Option

Bill of Materials

Symbol	Qty	Product #	Description
	1	rPP20 D 24V EFP G2	Relay Pack with 0-10V Dimming Output
	1	rPP20 D 24V EM EFP G2	Emergency Relay Pack with 0-10V Dimming Output
	2	rCMSB PDT 7 G2	Battery Powered Occupancy Sensor

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:


- Fixtures automatically go to full bright when occupied
- Fixtures automatically turn off or optionally can be configured to drop to low dim setting when space becomes vacant

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLLC), as specified in the IECC 2021 CODE.

ADDITIONAL OPTIONS:


- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLLC) (C405.2.5)
- For emergency lighting control use a power pack with ER/EM option or nLight Enabled Fixture with emergency option

Wired

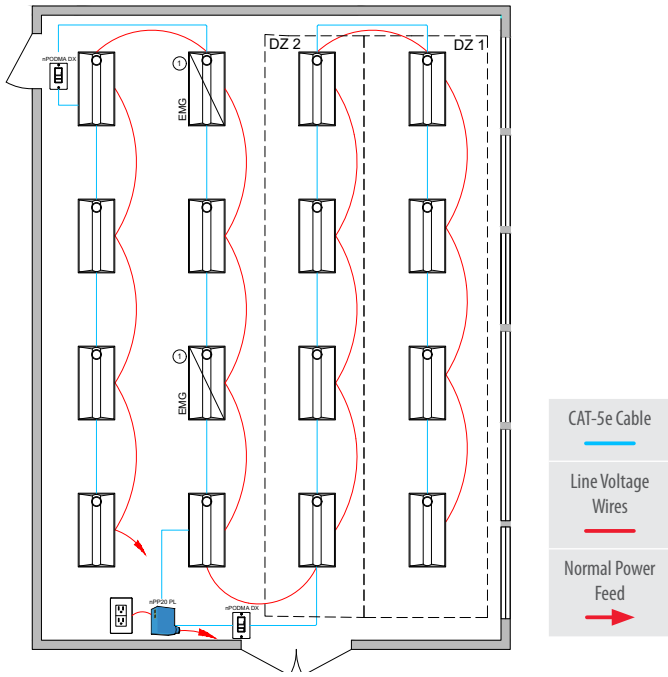

① Some nLight enabled emergency fixtures require separate normal and emergency connections. Wiring shown assumes battery backup emergency option. See fixture spec sheets for options and details.

Wireless

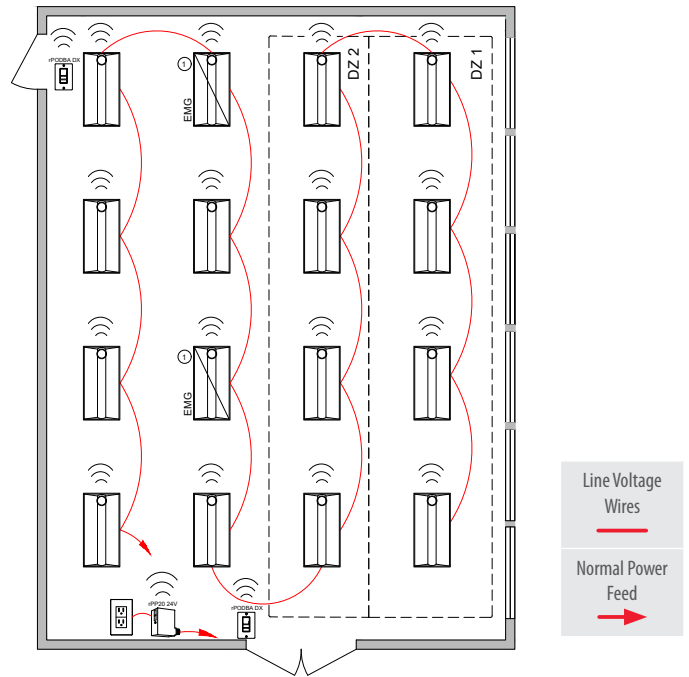

① Some nLight AIR enabled emergency fixtures require separate normal and emergency connections. Wiring shown assumes battery backup emergency option. See fixture spec sheets for options and details.

Bill of Materials

Symbol	Qty	Product #	Description
	14	See Note	nLight Wired Enabled Troffer with Sensor Option
	2	See Note	nLight Wired Enabled Troffer with Battery Option (typical) and Sensor Option
	2	nPODMA DX	On/Off, Raise/Lower WallPod
	1	nPP20 PL	Plug Load Relay Pack

Bill of Materials

Symbol	Qty	Product #	Description
	14	See Note	nLight AIR Enabled Troffer with Sensor Option
	2	See Note	nLight AIR Enabled Troffer with Sensor and Battery Option
	2	rPODBA DX G2	Battery Powered, On/Off, Raise/Lower WallPod
	1	rPP20 24V EFP G2	Plug Load Relay Pack

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- All fixtures are controlled together or independently
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:

- General lighting in each control zone may turn on to 100% upon occupancy. Unoccupied zones may come on automatically to not more than 20% or may stay off
- Fixtures and plug load automatically turn off when room becomes vacant
- General lighting must be controlled in zones not greater than 600 sq. ft.
- Plug load turns on automatically

Daylight Control:

- Smooth continuous dimming
- Daylight zones sizes defined by window size or skylight placement (not shown)
- Not required for offices without windows or that have loads <150W in sidelit zones

Manual Control:

- On/off & raise/lower control
- Raise/lower control is not required for spaces with occupancy sensors but is recommended



ADDITIONAL OPTIONS:

- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLLC) (C405.2.5)
- Occupant sensor controls in open plan office spaces less than 300 sq. ft. in area shall comply with Section C405.2.1.3

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLLC), as specified in the IECC 2021 CODE.

Wired

Wireless

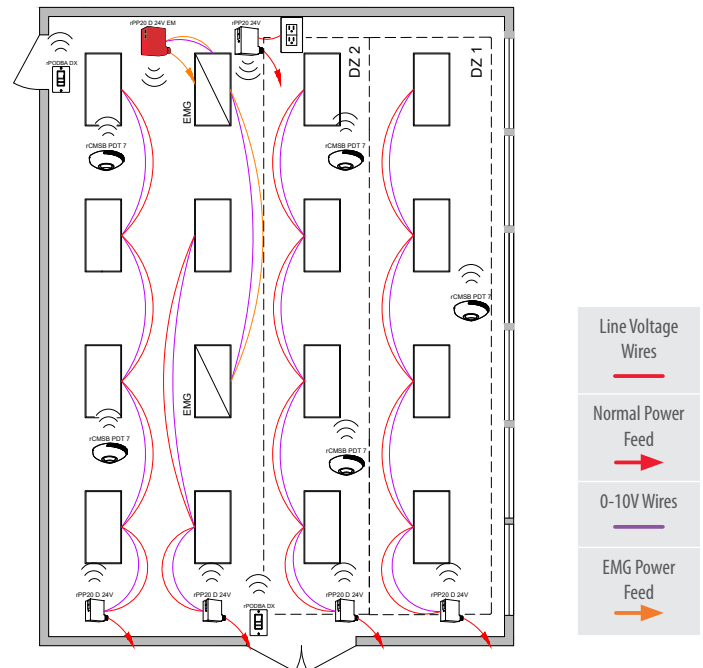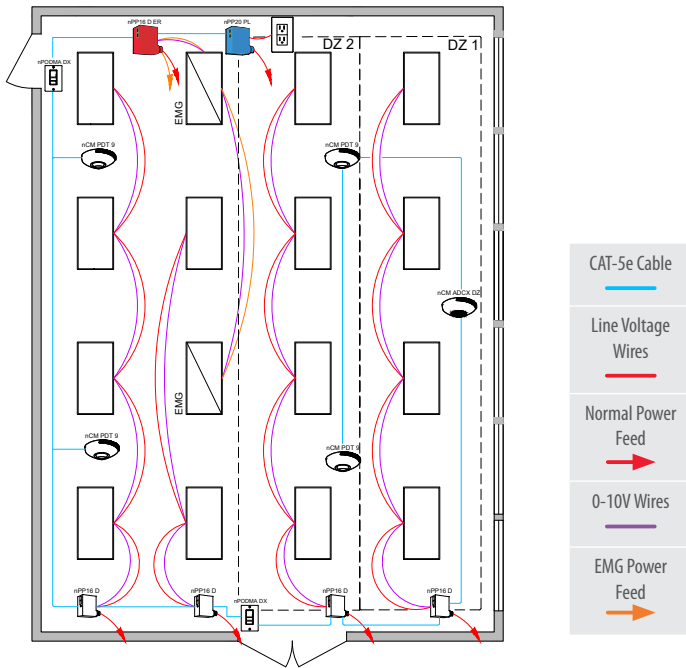

① nLight AIR devices with an EM option must be grouped with a normal power sensing device to exit emergency operation. See control device spec sheet for details.

Bill of Materials

Bill of Materials

Symbol	Qty	Product #	Description
	4	nPP16 D EFP	Relay Pack with 0-10V Dimming Output
	1	nPP16 D ER EFP	Emergency Relay Pack with 0-10V Dimming Output
	2	nPODMA DX	On/Off, Raise/Lower WallPod
	4	nCM PDT 9 RJB	Occupancy Sensor
	1	nCM ADCX DZ RJB	Dual Zone Daylight Sensor
	1	nPP20 PL	Plug Load Relay Pack

Symbol	Qty	Product #	Description
	4	rPP20 D 24V EFP G2	Relay Pack with 0-10V Dimming Output
	1	rPP20 D 24V EM EFP G2	Emergency Relay Pack with 0-10V Dimming Output
	2	rPODBA DX G2	Battery Powered, On/Off, Raise/Lower WallPod
	5	rCMSB PDT 7 G2	Battery Powered Occupancy and Daylight Sensor
	1	rPP20 24V EFP G2	Plug Load Relay Pack

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- Each row controlled independently
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:

- General lighting in each control zone may turn on to 100% upon occupancy. Unoccupied zones may come on automatically to not more than 20% or may stay off
- Fixtures and plug load automatically turn off when room becomes vacant
- Plug load turns on automatically
- General lighting must be controlled in zones not greater than 600 sq. ft.

Daylight Control:

- Smooth continuous dimming
- Daylight zones sizes defined by window size or skylight placement (not shown)
- Not required for offices without windows or that have loads <150W in sidelit zones


Manual Control:

- On/off & raise/lower control
- Raise/lower control is not required for spaces with occupancy sensors but is recommended


ADDITIONAL OPTIONS:

- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- Occupant sensor controls in open plan office spaces less than 300 sq. ft. in area shall comply with Section C405.2.1.3

Wired

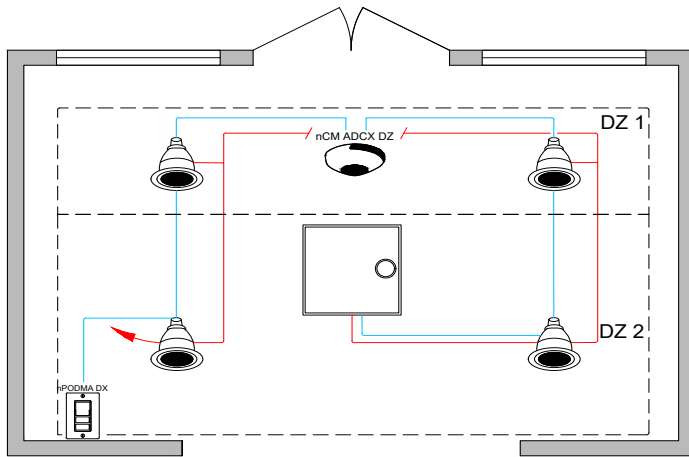

Wireless

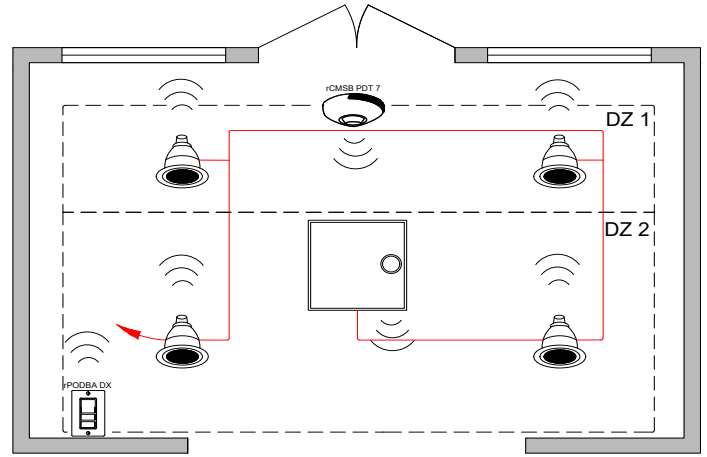

Bill of Materials

Symbol	Qty	Product #	Description
	4	See Notes	nLight Wired Enabled Downlight
	1	See Notes	nLight Wired Enabled Troffer with Sensor Option
	1	nPODMA DX	On/Off, Raise/Lower WallPod
	1	nCM ADCX DZ RJB	Dual Zone Daylight Sensor

Bill of Materials

Symbol	Qty	Product #	Description
	4	See Notes	nLight AIR Enabled Downlight
	1	See Notes	nLight AIR Enabled Troffer with Sensor Option
	1	rPODBA DX G2	Battery Powered, On/Off, Raise/Lower WallPod
	1	rCMSB PDT 7 G2	Battery Powered Occupancy and Daylight Sensor

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:

- Fixtures automatically go to full bright when occupied
- Fixtures automatically turn off when room becomes vacant

Daylight Control:

- Smooth continuous dimming
- Daylight zones sizes defined by window size or skylight placement (not shown)
- Not required for areas without windows or that have loads <150W in sidelit zones

Manual Control:


- On/off & raise/lower control of fixtures
- Raise/lower control is not required for spaces with occupancy sensors but is recommended

ADDITIONAL OPTIONS:


- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLLC) (C405.2.5)
- For emergency lighting control use a power pack with ER/EM option or nLight Enabled Fixture with emergency option

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLLC), as specified in the IECC 20121 CODE.

Wired

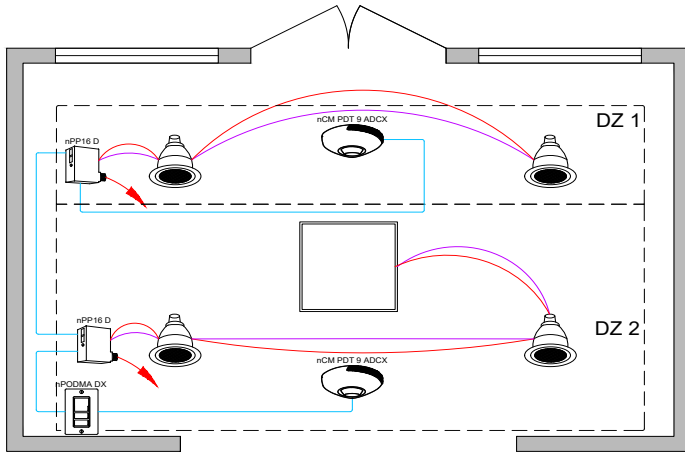

Wireless

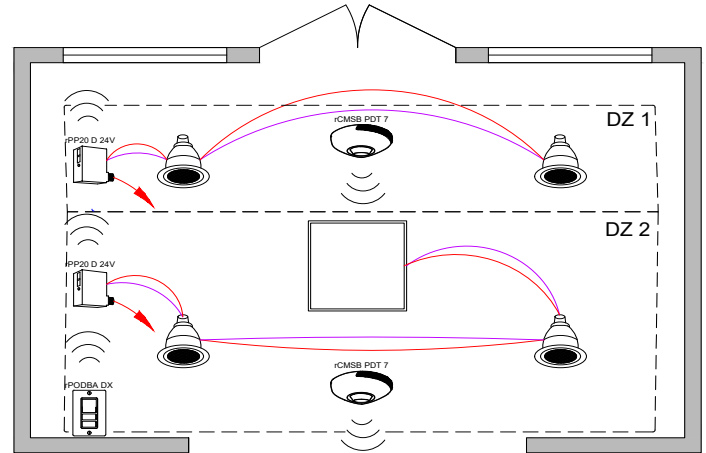

Bill of Materials

Symbol	Qty	Product #	Description
	2	nPP16 D EFP	Relay Pack with 0-10V Dimming Output
	1	nPODMA DX	On/Off, Raise/Lower WallPod
	2	nCM PDT 9 ADCX	Occupancy and Daylight Sensor

Bill of Materials

Symbol	Qty	Product #	Description
	2	rPP20 D 24V EFP G2	Relay Pack with 0-10V Dimming Output
	1	rPODBA DX G2	Battery Powered, On/Off, Raise/Lower WallPod
	2	rCMSB PDT 7 G2	Battery Powered Occupancy and Daylight Sensor

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:

- Fixtures automatically go to full bright when occupied
- Fixtures automatically turn off when room becomes vacant

Daylight Control:

- Smooth continuous dimming
- Daylight zones defined by relay module wiring
- Not required for areas without windows or that have loads <150W in sidelit zones


Manual Control:

- On/off & raise/lower control of fixtures
- Raise/lower control is not required for spaces with occupancy sensors but is recommended


ADDITIONAL OPTIONS:

- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- For emergency lighting control use a power pack with ER/EM option or nLight Enabled Fixture with emergency option

Wired

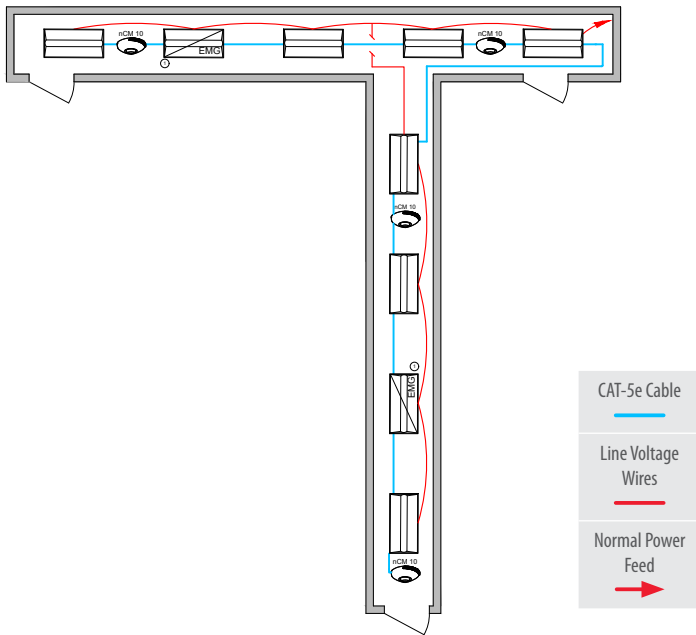

Wireless

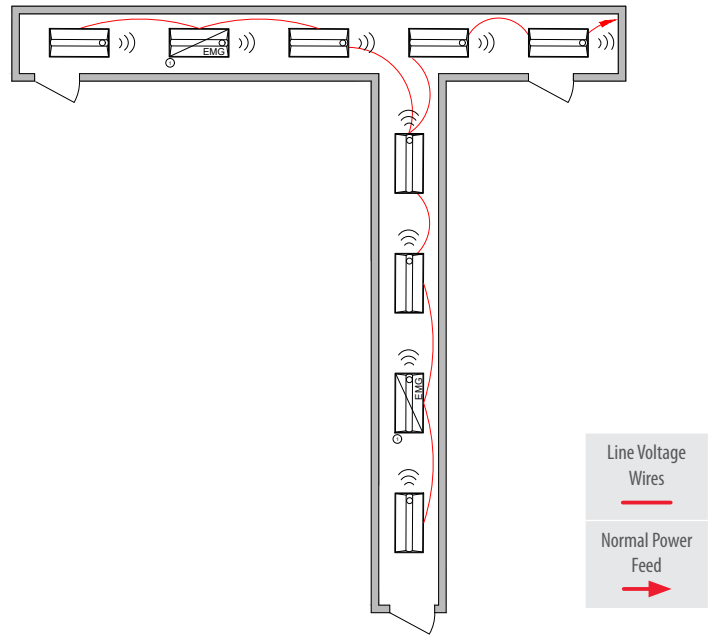

① Some nLight enabled emergency fixtures require separate normal and emergency connections. Wiring shown assumes battery backup emergency option. See fixture spec sheets for options and details.

① Some nLight AIR enabled emergency fixtures require separate normal and emergency connections. Wiring shown assumes battery backup emergency option. See fixture spec sheets for options and details.

Bill of Materials

Symbol	Qty	Product #	Description
	7	See Note	nLight Wired Enabled Troffer with Sensor Option
	2	See Note	nLight Wired Enabled Troffer with Battery Option
	4	nCM 10 RJB	Occupancy Sensor

Bill of Materials

Symbol	Qty	Product #	Description
	7	See Note	nLight AIR Enabled Troffer with Sensor Option
	2	See Note	nLight AIR Enabled Troffer with Battery Option

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- All fixtures are controlled together or independently
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:


- Fixtures automatically go to full bright when occupied
- Fixtures automatically turn off or optionally can be configured to drop to low dim setting when space becomes vacant

ADDITIONAL OPTIONS:


- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLLC) (C405.2.5)

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLLC), as specified in the IECC 2021 CODE.

Wired

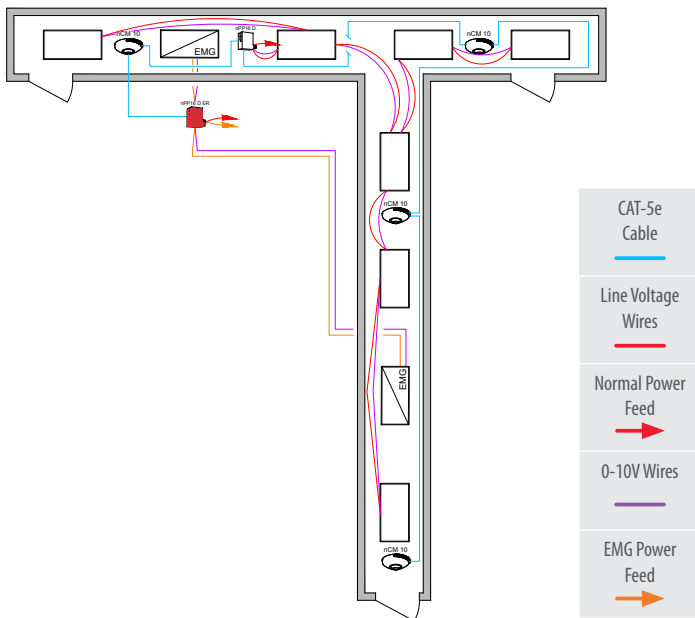

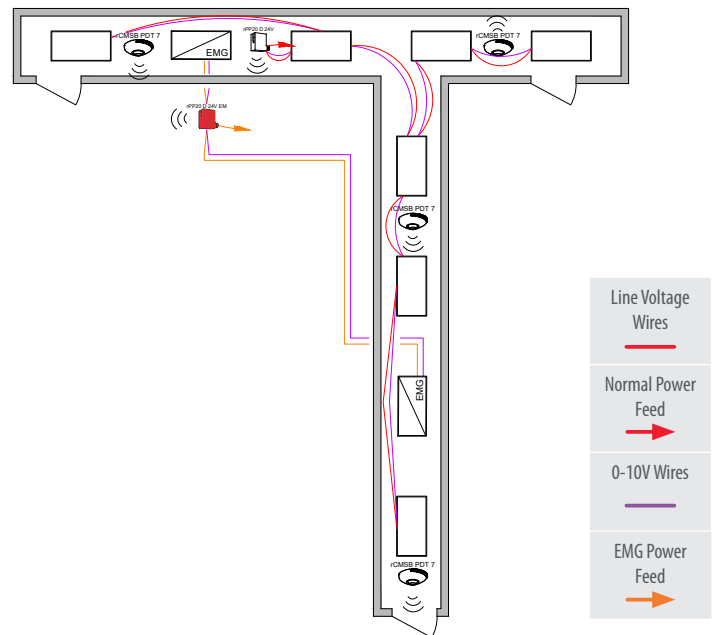


Wireless






① nLight AIR devices with an EM option must be grouped with a normal power sensing device to exit emergency operation. See control device spec sheet for details.

Bill of Materials

Symbol	Qty	Product #	Description
	1	nPP16 D EFP	Relay Pack with 0-10V Dimming Output
	1	nPP16 D ER EFP	Emergency Relay Pack with 0-10V Dimming Output
	4	nCM 10 RJB	Occupancy Sensor

Bill of Materials

Symbol	Qty	Product #	Description
	1	rPP20 D 24V EFP G2	Relay Pack with 0-10V Dimming Output
	1	rPP20 D 24V EM EFP G2	Emergency Relay Pack with 0-10V Dimming Output
	4	rCMSB PDT 7 G2	Battery Powered Occupancy Sensor

/ OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- Maximum level can be task tuned to any percentage via programming


Occupancy Control:

- Fixtures automatically go to full bright when occupied
- Fixtures automatically turn off or optionally can be configured to drop to low dim setting when space becomes vacant

/ ADDITIONAL OPTIONS:

- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- For emergency lighting control use a power pack with ER/EM option or nLight Enabled Fixture with emergency option


Wired

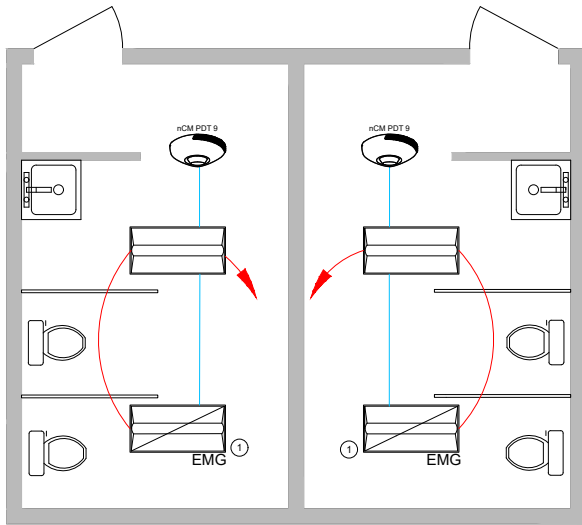

- ① Some nLight enabled emergency fixtures require separate normal and emergency connections. Wiring shown assumes battery backup emergency option. See fixture spec sheets for options and details.



Wireless

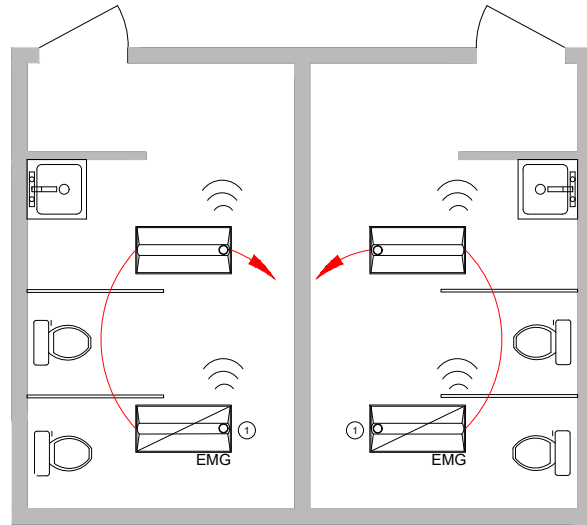

- ① Some nLight AIR enabled emergency fixtures require separate normal and emergency connections. Wiring shown assumes battery backup emergency option. See fixture spec sheets for options and details.



Bill of Materials

Symbol	Qty	Product #	Description
	2	See Note	nLight Wired Enabled Troffer
	2	See Note	nLight Wired Enabled Troffer with Battery Option
	2	nCM PDT 9 RJB	Occupancy Sensor

Bill of Materials

Symbol	Qty	Product #	Description
	2	See Note	nLight AIR Enabled Troffer with Sensor Option
	2	See Note	nLight AIR Enabled Troffer with Battery Option

/ OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- All fixtures are controlled together or independently (per room)
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:


- Fixtures automatically go to full bright when occupied (or optionally can be configured to come on automatically to 50%)
- Fixtures automatically turn off when space becomes vacant

/ ADDITIONAL OPTIONS:


- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- Fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLC) (C405.2.5)

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLC), as specified in the IECC 2021 CODE.

Wired

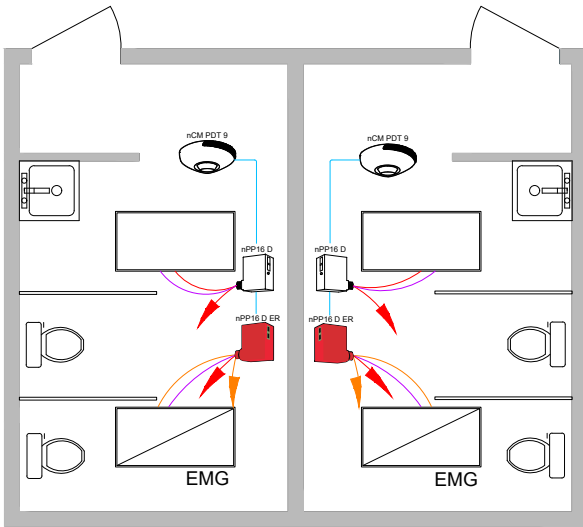

Wireless

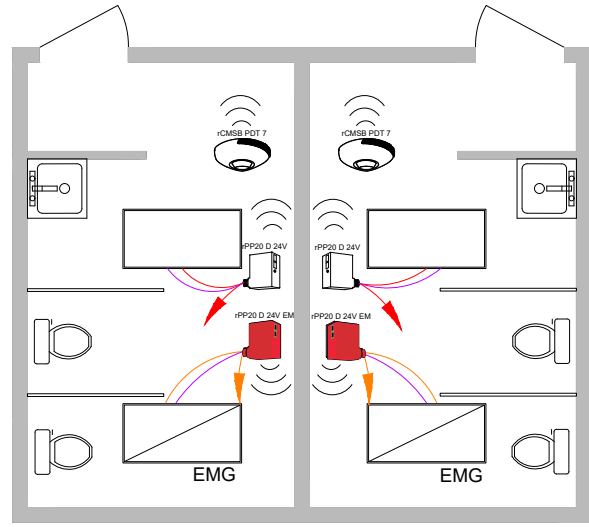

① nLight AIR devices with an EM option must be grouped with a normal power sensing device to exit emergency operation. See control device spec sheet for details.



Bill of Materials

Symbol	Qty	Product #	Description
	2	nPP16 D EFP	Relay Pack with 0-10V Dimming Output
	2	nPP16 D ER EFP	Emergency Module with 0-10V Dimming Output
	2	nCM PDT 9 RJB	Occupancy Sensor

Bill of Materials

Symbol	Qty	Product #	Description
	2	rPP20 D 24V EFP G2	Relay Pack with 0-10V Dimming Output
	2	rPP20 D 24V EM EFP G2	Emergency Relay Pack with 0-10V Dimming Output
	2	rCMSB PDT 7 G2	Battery Powered Occupancy Sensor

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- All fixtures are controlled together or independently (per room)
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:


- Fixtures automatically go to full bright when occupied (or optionally can be configured to come on automatically to 50%)
- Fixtures automatically turn off when space becomes vacant

ADDITIONAL OPTIONS:

- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- For emergency lighting control use a power pack with ER/EM option or nLight Enabled Fixture with emergency option

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLLC), as specified in the IECC 2021 CODE.

Wireless with nLight Enabled Fixtures

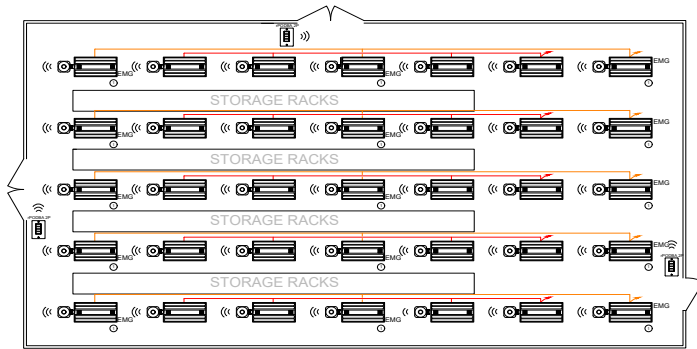

1 Fixture(s) assumed to include nLight AIR EM emergency options. For battery backup option, no dedicated emergency circuit necessary. nLight AIR devices with an EM option must be grouped with a normal power sensing device to exit emergency operation. See control device spec sheet for details.



Bill of Materials

Symbol	Qty	Product #	Description
	20	See Note	nLight AIR Enabled High Bay Fixture with Sensor Option
	15	See Note	nLight AIR Enabled High Bay Fixture with Sensor and EM Option
	3	rPODBA 2P G2	Battery Powered, 2-Pole, On/Off WallPod

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:

- Fixtures automatically go to full bright when occupied
- Fixtures automatically turn off or optionally can be configured to drop to low dim setting when space becomes vacant

Daylight Control:


- Daylight responsive controls lights to full off when adequate daylight present
- Not required for spaces without skylights or that have loads <150W in toplit zones

Manual Control:

- Safety may preclude the use of a manual control in these areas

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLLC), as specified in the IECC 2021 CODE.

Wireless with 0-10V Dimming Fixtures

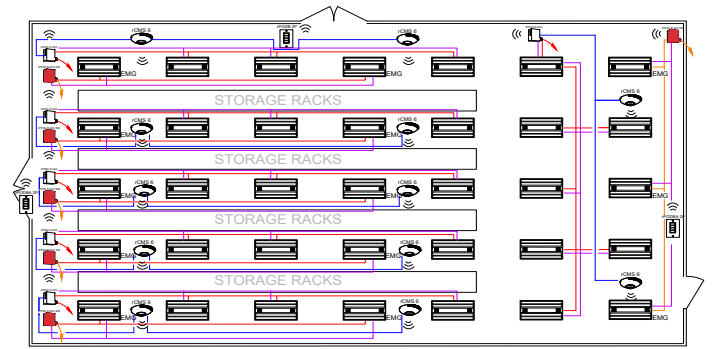

1 nLight AIR devices with an EM option must be grouped with a normal power sensing device to exit emergency operation. See control device spec sheet for details.




Bill of Materials

Symbol	Qty	Product #	Description
	6	rPP20 D 24V EFP G2	Relay Pack with 0-10V Dimming Output
	6	rPP20 D 24V EM EFP G2	Emergency Relay Pack with 0-10V Dimming Output
	3	rPODBA 2P G2	Battery Powered, 2-Pole, On/Off WallPod
	12	rCMS 6 G2	Occupancy Sensor

ADDITIONAL OPTIONS:

- Room can be connected to nLight backbone to enable network control or time schedules (C405.2.2.1 - Time-Switch Controls), and also qualify for Enhanced Digital Lighting Controls (C406.4)
- HVAC control available through system-wide BACnet® interface option on the ECLYPSE controller
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLLC) (C405.2.5)

Wireless Parking Garage

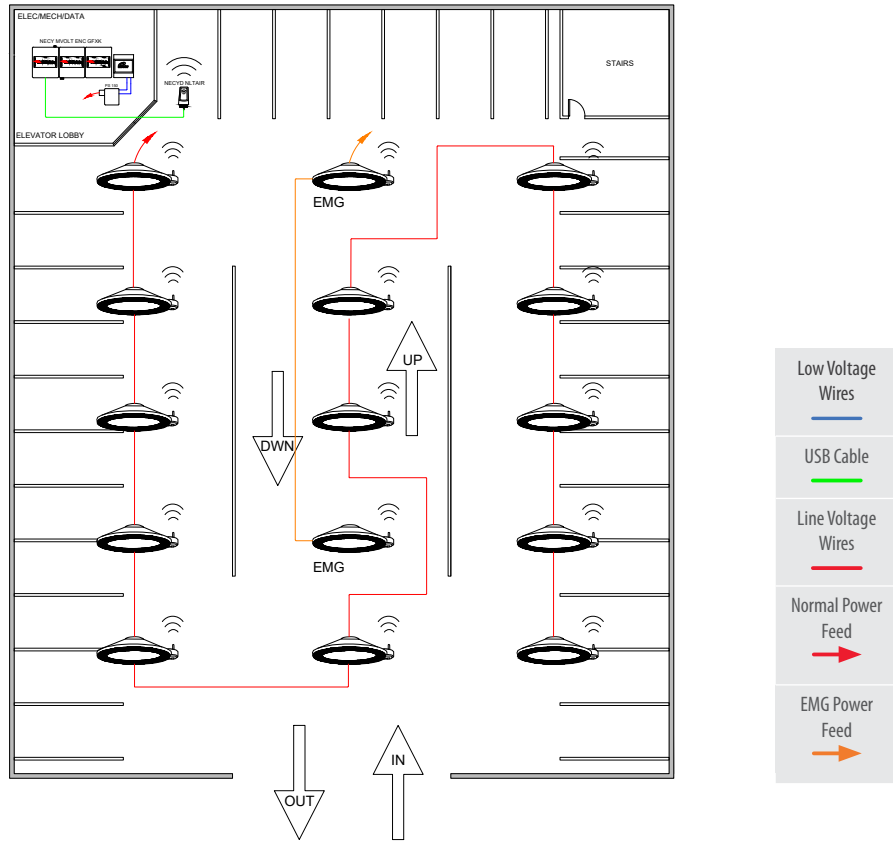

① Fixture(s) assumed to include nLight AIR EM emergency options. For battery backup option, no dedicated emergency circuit necessary. nLight AIR devices with an EM option must be grouped with a normal power sensing device to exit emergency operation. See control device spec sheet for details.

Bill of Materials

Symbol	Qty	Product #	Description
	13	See Note	nLight AIR Enabled Canopy Fixture with Sensor Option
	2	See Note	nLight AIR Enabled Canopy Fixture with Sensor and EM Option
	1	nECY	nLight ECLYPSE Network System Controller
	1	nECYD NLTAIR G2	nLight AIR Adapter

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- All fixtures can be controlled together or independently
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:

- Fixtures automatically go to full bright when occupied
- Fixtures automatically turn off or optionally can be configured to drop to low dim setting when space becomes vacant

Daylight Control:


- Daylight responsive controls lights to full off when adequate daylight present

ADDITIONAL OPTIONS:




- Devices can be connected to nLight backbone to enabled network control or time schedules, including time schedules (C405.2.2.1), lighting setback (C405.2.7.3), & exterior time-switch control (C405.2.6.4).
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLLC) (C405.2.5)

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLLC), as specified in the IECC 2021 CODE.

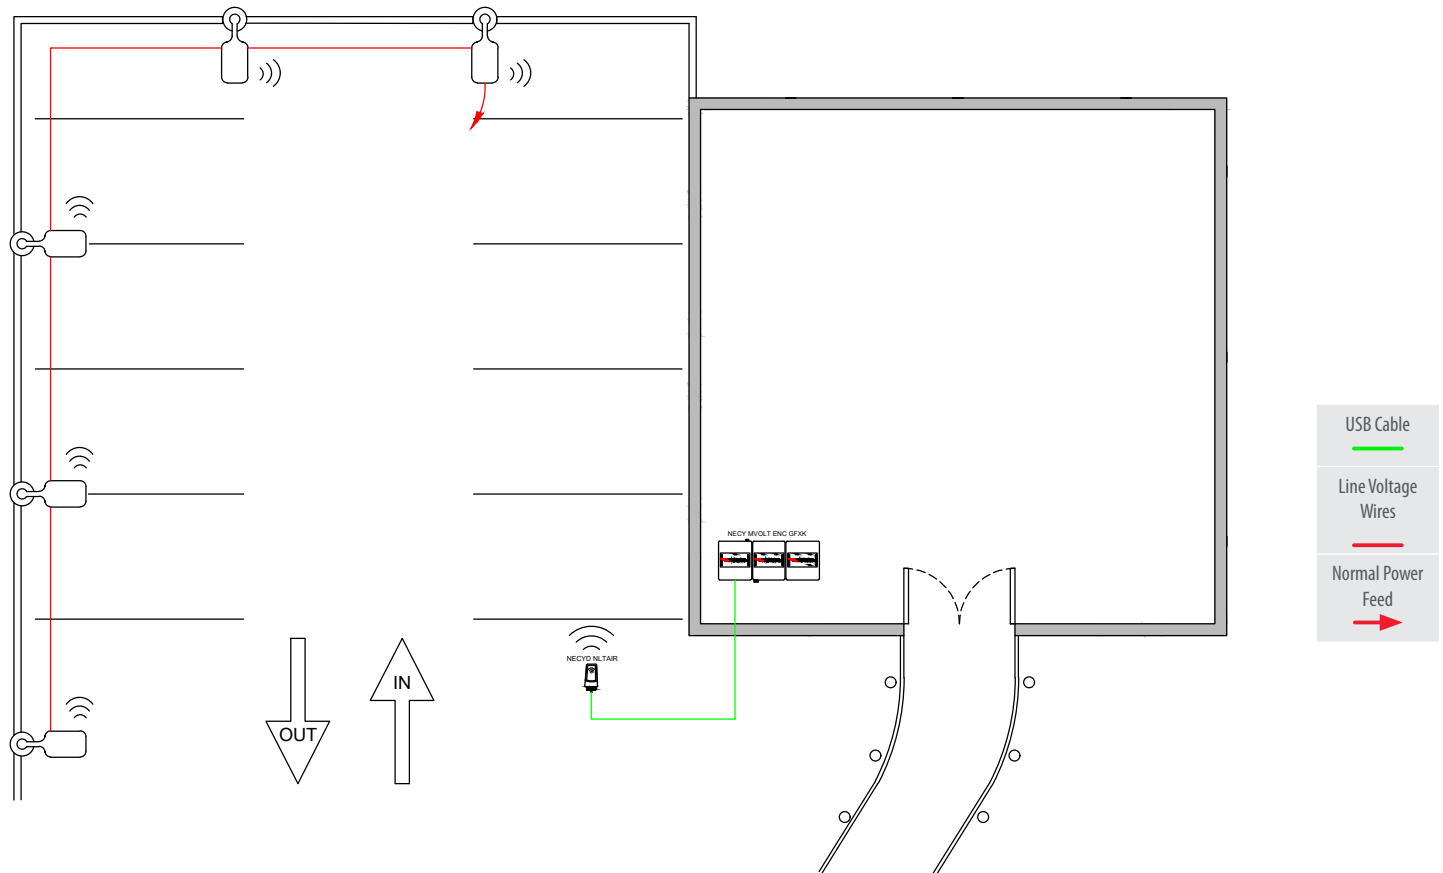Wireless Site/Parking Area



Bill of Materials

Symbol	Qty	Product #	Description
	5	See Note	nLight AIR Enabled Area Fixture
	1	nECY	nLight ECLYPSE Network System Controller
	1	nECYD NLTAIR G2	nLight AIR Adapter

/ OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- All fixtures can be controlled together or independently
- Maximum level can be task tuned to any percentage via programming

Occupancy Control:

- Fixtures automatically go to full bright when occupied
- Fixtures automatically turn off or optionally can be configured to drop to low dim setting when space becomes vacant

Daylight Control:


- Daylight responsive controls lights to full off when adequate daylight present

/ ADDITIONAL OPTIONS:

- Devices can be connected to nLight backbone to enabled network control or time schedules, including time schedules (C405.2.2.1), lighting setback (C405.2.7.3), & exterior time-switch control (C405.2.6.4).
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLC) (C405.2.5)

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLC), as specified in the IECC 2021 CODE.

Wireless Facade and Landscaping

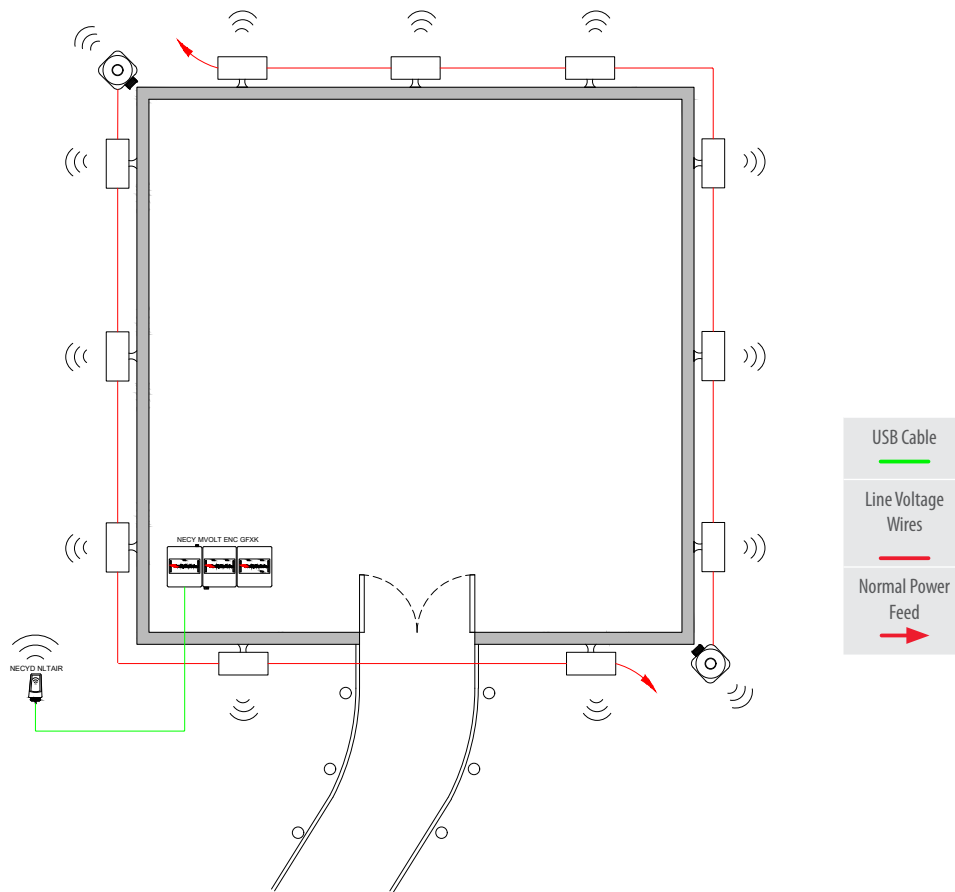

Bill of Materials

Symbol	Qty	Product #	Description
	11	See Note	nLight AIR Enabled Wall Mount
	1	nECY	nLight ECLYPSE Network System Controller
	1	nECYD NLTAIR G2	nLight AIR Adapter
	2	rSBOR	nLight AIR Sensor and Wireless Repeater

OPERATIONAL DETAILS:

Light Fixtures:

- All fixtures are dimmable
- All fixtures can be controlled together or independently
- Maximum level can be task tuned to any percentage via programming

Daylight Control:



- Daylight responsive controls lights to full off when adequate daylight present

ADDITIONAL OPTIONS:

- Devices can be connected to nLight backbone to enabled network control or time schedules, including time schedules (C405.2.2.1), lighting setback (C405.2.7.3), & exterior time-switch control (C405.2.6.4).
- Wireless fixture embedded control and occupancy/daylighting sensor options available, please see the fixture specification sheet
- nLight enabled fixtures comply with monitoring and configuration requirements of Luminaire Level Lighting Controls (LLC) (C405.2.5)

Note: Contact your local lighting agent for more information on nLight enabled fixtures. nLight enabled fixtures provide Luminaire Level Lighting Controls (LLC), as specified in the IECC 2021 CODE.

nLight Hybrid Network

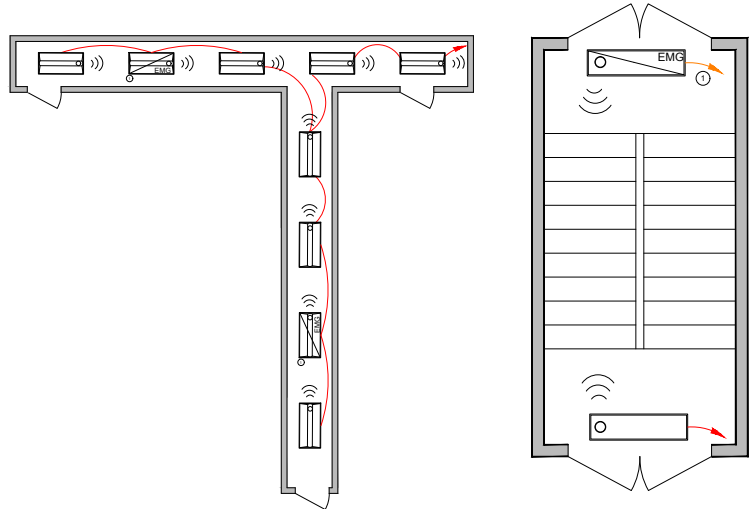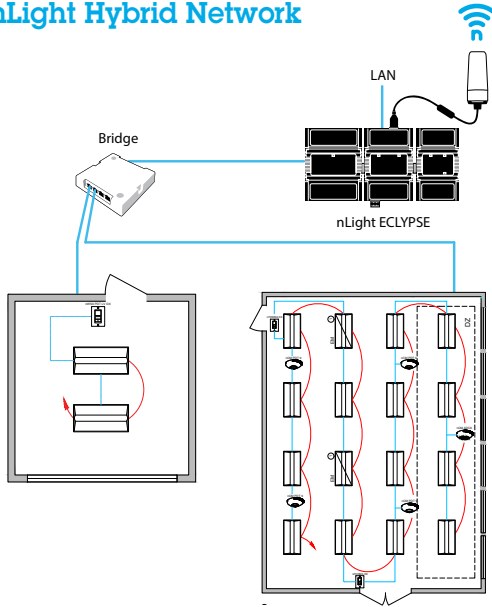










Bill of Materials

Symbol	Qty	Product #	Description
	1	nBRG 8 KIT	8-Port Backbone Bridge
	1	nECY MVOLT ENC	nLight ECLYPSE Network System Controller and Optional BMS Interface
	1	nECYD NLTAIR G2	nLight AIR Adapter

Programmable Time Clock Control:

Although not pictured within each of the individual room design guides, each nLight controlled space can be connected via an nLight backbone to create a networked nLight lighting control system capable of meeting the requirements of IECC 2021 Provision C405.2.2.1, Time-Switch Controls.

Control Requirement	Code Provision	nLight Solution Details	
Manual Control (Local Switch)	C405.2.1.1.3	nLight WallPod devices provide a user with local control of lighting within an nLight controlled space. WallPods are available in multiple styles – each with varying features and user experiences.	
		Push-Button WallPod nPODMA Series rPODBA Series 	Graphic WallPod* nLight UNITOUCH Touchscreen Wall Switch 
		Traditional tactile buttons and LED user feedback.	Full-color touch screen provides a sophisticated look and feel.
Shut-Off Control Time-Switch Controls and Exterior Lighting Control (via System Controller)	C405.2.2.1 C405.2.7.2 C405.2.7.3.1.1 C405.2.7.3.1.2 C405.2.7.4	Individual nLight control groups (i.e.: rooms) can be easily networked together across an entire building simply by connecting them into a “backbone” made up of one or more nLight bridge devices and/or nLight AIR adapters and an nLight ECLYPSE system controller. The system controller provides programmable time clock functionality for an nLight network as well as interfaces to the SensorView suite of web-based software applications (via an Ethernet LAN / WAN connection).	
		Network System Controller	
		Network System Controller 	
Full Auto-Off via Occupancy Sensor	C405.2.1.1	nLight occupancy sensors utilize 100% digital passive infrared (PIR) detection, come in several mounting styles, and offer multiple coverage pattern options. Additionally, nLight sensors are available with patented Microphonics™ dual technology detection for rooms with obstructions. Configuring for full off vs. partial off control is done with system programming.	
Manual On, Auto-On, <=50%, Full Automatic On	C405.2.1.1, Exception	360° Occupancy Sensor nCM Series rCMS Series rCMSB Series 	120° WideView Corner Sensor* nWV Series 
		Surface mounts to ceiling tiles or sheetrock/plaster.	Directly mounts in corner or to ceiling via repositionable ceiling bracket.
		nLight provides multiple options for controlling continuous dimming luminaires. This allows spaces with several lighting types and technologies to be controlled together and with a common user experience.	
Light-Reduction Controls	C405.2.3.1	nLight Enabled Acuity Brands Fixtures 	Dimming Relay Packs nPP16 Series rPP20 Series 
		Acuity Brands offers a wide variety of LED fixtures with factory installed integrated nLight controls that provide smooth continuous dimming.	nLight dimming relay enable control of any 0-10VDC dimmable LED luminaire.
		nLight offers standalone daylight harvesting sensors as well as occupancy sensors with integrated daylight harvesting. Sensors are available in various housings and provide continuous dimming control of any/all networked nLight enabled fixtures or dimming relay packs, each capable of being its own daylight zone.	
Daylight-Responsive Controls	C405.2.4.1 C405.2.4.2 C405.2.7.1 C405.2.8.2 C405.2.8.3	Ceiling Mount Dimming Photocell nCM Series rCMSB Series 	Recessed Mount Dimming Photocell* nRM Series 

*Available with nLight Wired products only.

Note: This summary is for general information purposes only and is provided without any warranty as to accuracy, completeness, or otherwise. The user should read the applicable code sections for more complete and detailed descriptions of code requirements and exceptions and should consult with a professional engineering or other competent advisor before making any decision or taking any action based on this summary.

2021 IECC and Emergency Lighting

The nLight platform offers flexible, UL 924 compliant control of emergency lighting. It addresses the needs of conventional projects that use extra wiring to charge battery packs inside of fixtures or to tell control devices to enter an emergency state when normal power is lost. Traditional lighting controls would make use of a shunt device in addition to a lighting control device (Figure 1). nLight consolidates the shunt device and lighting control device into a single digital device, which reduces installation and maximizes control (Figure 2). Wireless products also offer power detection through devices connected to normal power to initiate emergency control when normal power is lost. This modern method removes the need for extra wiring, further reducing the cost of installing emergency controls without sacrificing the intelligence and configurability that is expected from nLight devices (Figure 3).

IECC lighting controls requirement C405.2 (and subsection 405.2.7 for exterior lighting controls) provides exceptions for emergency and egress lighting, indicating that lighting controls are not required for the following types of lighting:

- Areas designated as security or emergency areas that are required to be continuously lighted.
- Interior exit stairways, interior exit ramps and exit passageways.
- Emergency egress lighting that is normally off.
- Lighting for covered vehicle entrances or exits from buildings or parking structures where required for safety, security or eye adaptation.

Generally speaking, lighting that is normally on during occupied periods, normally dimmed or off during unoccupied periods, and also used to provide for egress during emergency power conditions should be controlled in compliance with C405.2. nLight features various UL 924 listed options that can be specified to provide both lighting control in compliance with IECC and emergency operation in compliance with locally enforced fire codes.

Traditional Shunt

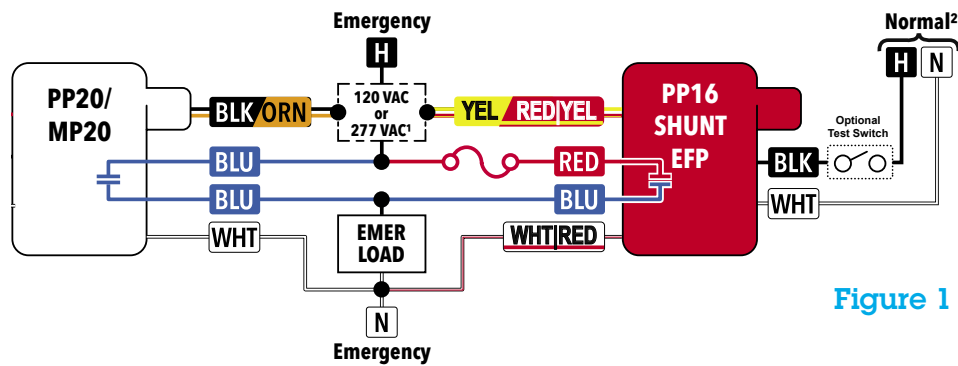


Figure 1

Control With Built-In Emergency Option Via Normal Power Sense

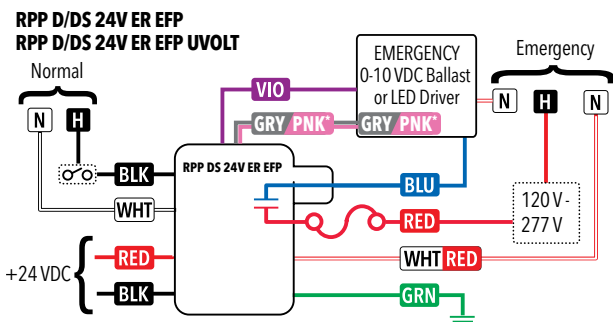


Figure 2

Control With Built-In Emergency Option Via nLight AIR EM

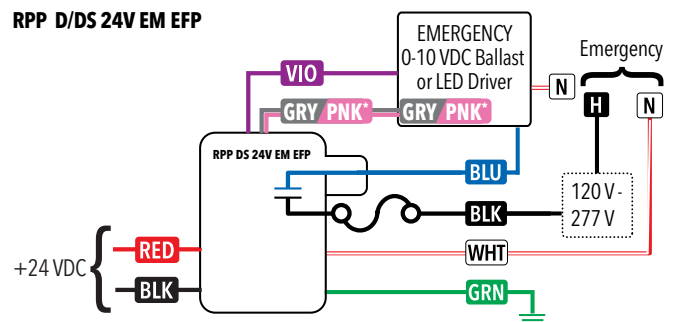


Figure 3

nLight Enabled Fixtures

Acuity Brands offers the industry's broadest portfolio of controls enabled fixtures. Please scan the QR code to see the current nLight enabled fixtures.



nLight AIR Enabled Luminaires



nLight Wired Enabled Luminaires

CLAIRITY™ + Mobile App

Quick and Easy Lighting Configuration and Control In the Palm of Your Hand


nLight Wired



The nLight Wired micro-application of CLAIRITY+ is a cost-effective method that simplifies programming and reduces start-up times for nLight devices in smaller projects.

The Bluetooth® word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. and any use of such marks by Acuity Brands Lighting is under license.

nLight AIR



The nLight AIR application provides easy startup, configuration and modification of nLight® AIR wireless controls. This cloud connected app allows validated end users (electrical contractors, sales agents or facility maintenance professionals) to start up, configure and troubleshoot from a compatible smartphone or tablet.



Additional Resources

Acuity Controls Typical Layout Drawings

<https://www.acuitybrands.com/resources/tools-and-documents/typicals>

IECC

<http://www.iccsafe.org/>

Use the Following Sections of the IECC 2021 Code as Reference:

- Section C405.2.1.1.2 – Manual-On or Partial-On
- Section C405.2.1.1, – Full Automatic On
- Exception
- Section C405.2.6.1 – Local Switch
- Section C405.2.2.1 – Programmable Timeclock
- Section C405.2.4 – Daylight-Responsive Controls
- Section C405.2.3.1 – Manual Lighting Reduction
- Section C405.2.7 – Exterior Lighting Controls
- Section C406.4 – Enhanced Digital Lighting Controls

Explore Acuity Academy

Acuity Academy provides educational resources for individuals wanting to expand their lighting, controls and building management technical knowledge. On Acuity Academy, you can register for instructor-led classes, take e-learning courses or watch videos and recorded content. <https://www.acuitybrands.com/resources/training-and-education>

nLight Lighting Controls Platform Page

www.nlightcontrols.com



A+ Certified solutions from Acuity Brands help you quickly and confidently select and implement lighting systems that are both compatible and consistent.

For lighting applications, A+ means verified consistent performance, visual appearance and system interoperability of all luminaires and controls within the certified solutions. For lighting professionals it means confidence that all parts of the lighting system will work together and meet common Acuity Brands specifications.

Go to www.acuitybrands.com/solutions/a-certified or contact your local Acuity Brands representative for more information.

The Bluetooth® word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. and any use of such marks by Acuity Brands Lighting is under license.